



FOUNDATION TO SECOND FLOOR LEVEL	COLUMN SIZE	B L	CONCRETE MIX	C1	C2	C3	C4	C5	C6	C7	C8
				9" 15"	9" 18"	9" 18"	9" 18"	9" 24"	9" 24"	9" 24"	12" 24"
SECTION WITH MAIN STEEL											
STIRRUPS				6 - 16 mm. Tor	8 - 16 mm. Tor	10 - 16 mm. Tor	4 - 20 mm. Tor + 6 - 16 mm. Tor	6 - 20 mm. Tor + 4 - 16 mm. Tor	10 - 20 mm. Tor	12 - 20 mm. Tor	6 - 25 mm. Tor + 6 - 20 mm. Tor
				6" C/C AT ENDS 8" C/C AT MID PORTION	6" C/C AT ENDS 8" C/C AT MID PORTION	6" C/C AT ENDS 8" C/C AT MID PORTION	6" C/C AT ENDS 8" C/C AT MID PORTION	6" C/C AT ENDS 8" C/C AT MID PORTION	6" C/C AT ENDS 8" C/C AT MID PORTION	6" C/C AT ENDS 8" C/C AT MID PORTION	6" C/C AT ENDS 8" C/C AT MID PORTION


FOOTING SCHEDULE										
S.NO.	COLUMN MARKED	FOOTING	FOOTING SIZE		D	C	E	REINFORCEMENT		
			L	B				N	K	
1.	C1	F1	6'6"	6'6"	18"	8"	6"	10 mm.Tor @ 6" c/c	10 mm.Tor @ 6" c/c	
2.	C2	F2	7'6"	7'6"	20"	8"	6"	10 mm.Tor @ 5" c/c	10 mm.Tor @ 5" c/c	
3.	C3	F3	9'0"	9'0"	24"	8"	6"	12 mm.Tor @ 6" c/c	12 mm.Tor @ 6" c/c	
4.	C4	F4	9'6"	9'6"	26"	10"	6"	12 mm.Tor @ 6" c/c	12 mm.Tor @ 6" c/c	
5.	C5	F5	11'0"	10'0"	30"	10"	6"	12 mm.Tor @ 5" c/c	12 mm.Tor @ 5" c/c	
6.	C6	F6a	10'0"	12'0"	30"	10"	6"	12 mm.Tor @ 4" c/c	12 mm.Tor @ 5" c/c	
7.	C6	F6	11'0"	11'0"	30"	10"	6"	12 mm.Tor @ 5" c/c	12 mm.Tor @ 5" c/c	
8.	C7	F7	11'6"	11'6"	32"	10"	6"	12 mm.Tor @ 5" c/c	12 mm.Tor @ 5" c/c	
9.	C8	F8	13'6"	13'6"	34"	10"	6"	12 mm.Tor @ 4" c/c	12 mm.Tor @ 4" c/c	
10.	C8	F8A	11'0"	17'0"	36"	10"	6"	16 mm.Tor @ 6" c/c	12 mm.Tor @ 5" c/c	

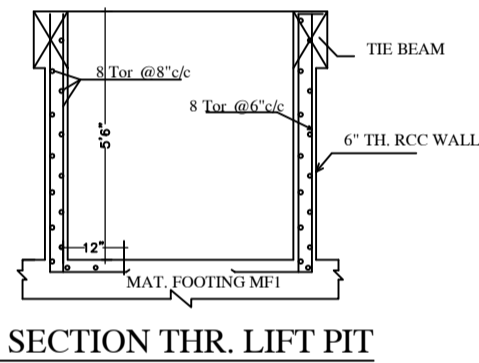

SECTION THR. LIFT PIT

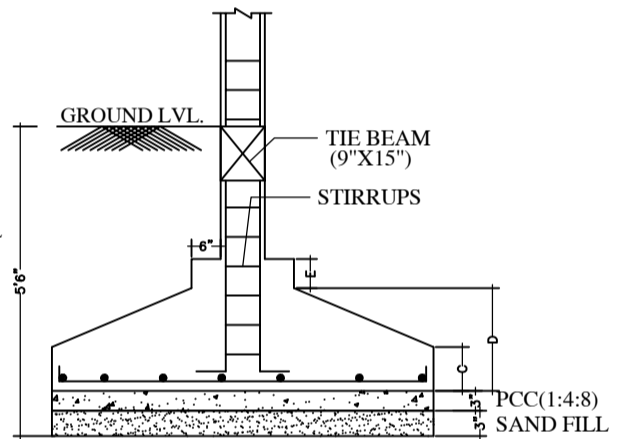

TYPICAL SECTION OF FOOTING

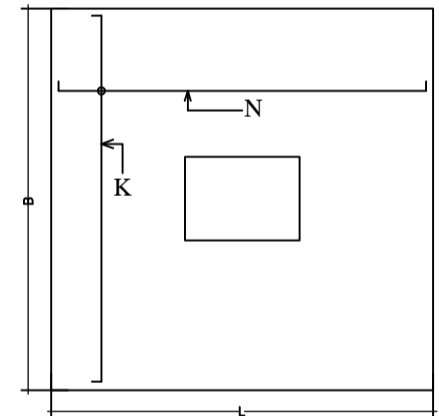

PLAN OF FOOTING