




SPECIFICATION

- DEPTH OF FOUNDATION WILL BE DEPEND ON THE SOIL, AS PER STRUCTURAL DETAILS, AS MENTIONED IN THE DRAWING
- FOUNDATION: R.C.C. COLLUMNS OVER 100mm THK. P.C.C. (1:3:6) OVER BRICK FLAT SOLING OVER 150mm THK. SAND FILLING.
- SUPER STRUCTURE: BRICK MASONRY SHALL BE DONE WITH FIRST CLASS BRICK IN CEMENT MORTAR(1:6) AND HALF BRICK WALL IN (1:4) CEMENT MORTAR ON THE FRAME STRUCTURE.
- D.P.C.: D.P.C SHALL BE WITH (1:2:4) CONCRETE WITH 3% CICCO MIXED
- R.C.C. WORK: ALL R.C.C WORK SHALL BE IN (1:1:2:4) MIXED CONCRETE(M20 GRADE).
- LINTEL & CHAJJA: R.C.C. LINTEL 150mm THK. SHOULD BE PROVIDED AT THE OPENING THROUGHOUT THE WALLS AND R.C.C. CHAJJA TO BE PROVIDED ON THE WINDOWS OPENING.
- R.C.C ROOF SLAB-100mm THK. AVERAGE LIME TERRACING OVER 112mm THK. R.C.C ROOF SLAB SHALL BE PROVIDED.
- PLASTERING: 15mm THK. CEMENT PLASTER FOR INSIDE AND 20 mm THK. FOR OUTSIDE WALL SURFACE IN (1:6) AND 6mm THK. CEMENT PLASTER IN (1:4) PROVIDED FOR R.C.C/CELLING SURFACE.
- FLOORING: 25mm THK. I.P.S. FLOORING WITH NEAT CEMENT MOSAIC FINISH SHALL BE PROVIDED AS PER SPECIFICATION ALONG WITH 150mm SKRTING.
- DOOR: CHOUKHAT (FRAME) ARE SAL WOOD (125X0625) FILLED WITH FLUSH/PANNEL TYPE SHUTTER SHALL BE USED.
- WINDOW: STEEL FRAME FOR WINDOWS AND VENTILATORS FILLED WITH GLAZED SHUTTER TO BE USED.
- FITTING: ALL SANITARY AND ELECTRICAL FITTINGS SHALL BE USED OF I.S.I STANDARD MARKS, COMMERCIAL QUALITY.
- FINISHING: ALL STEEL AND WOOD WORK SHALL BE PAINTED WITH SYNTHETIC PAINT TO BE FINISH.
- WHITE WASHING:THREE COATS WHITE WASH/ACRYLIC PAINTS FOR INSIDE SURFACE WITH SUITABLE COLORS AND CEMENT BASED PAINTS FOR OUTSIDE SURFACE SHALL BE PROVIDED.

SCHEDULE OF OPENING

SL. NO.	ITEM	TYPE	WIDTH	HEIGHT	SILL LVL.	DISCRPTION
1.	DOORS	D	1.050	2.100	NILL	SINGLE SHUTTER FLUSH DOOR
		D1	.975	2.100	NILL	"
		D2	.900	2.100	NILL	"
		D3	.750	2.100	NILL	"
2.	WINDOWS	W1	1.500	1.200	.900	4 LEAF GLAZED WINDOW
		W2	1.200	1.200	.900	3 LEAF GLAZED WINDOW
		W3	.900	1.200	.900	2 LEAF GLAZED WINDOW
3.	VENTILATOR	V	.600	.600	1.500	VENTILATOR

AREA STATEMENT

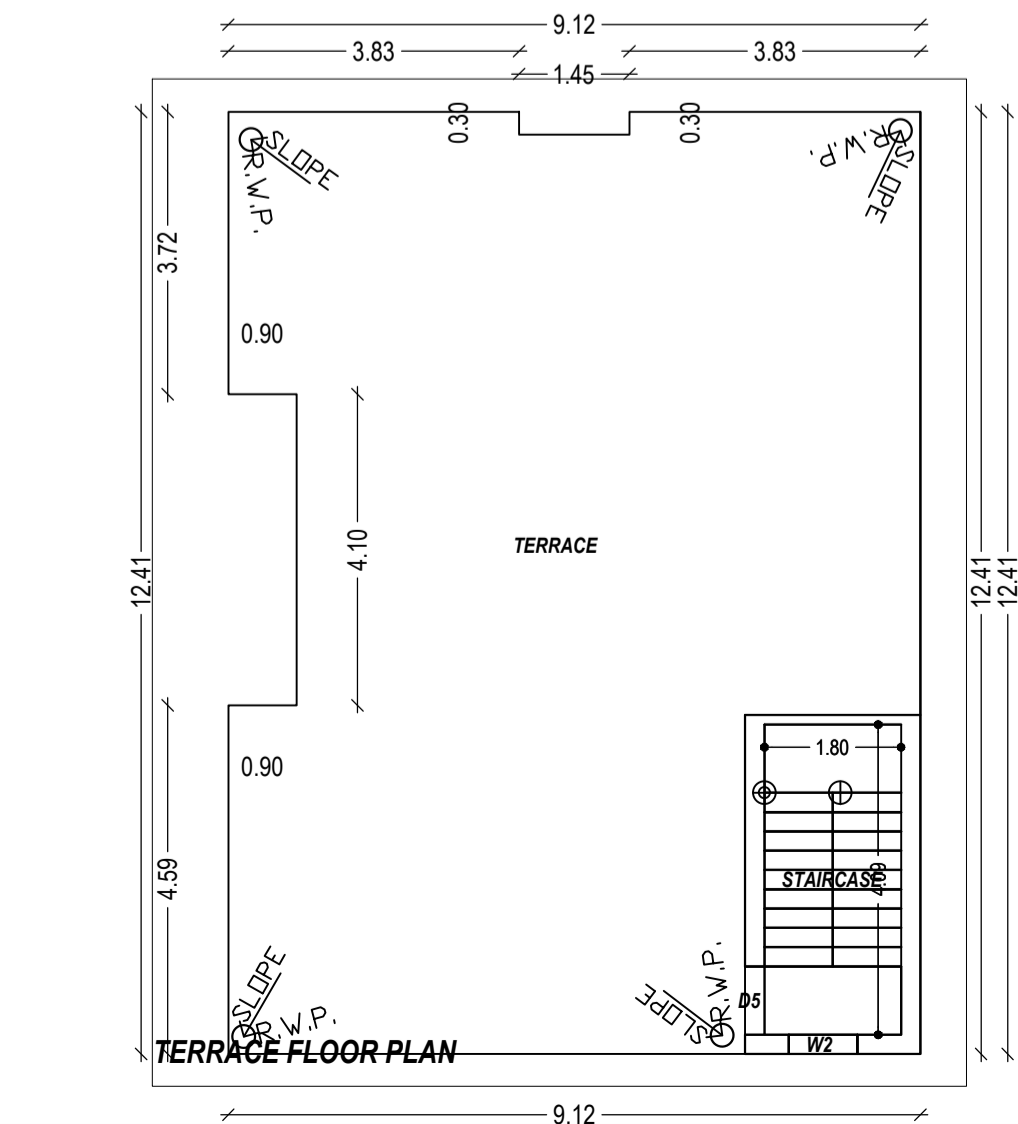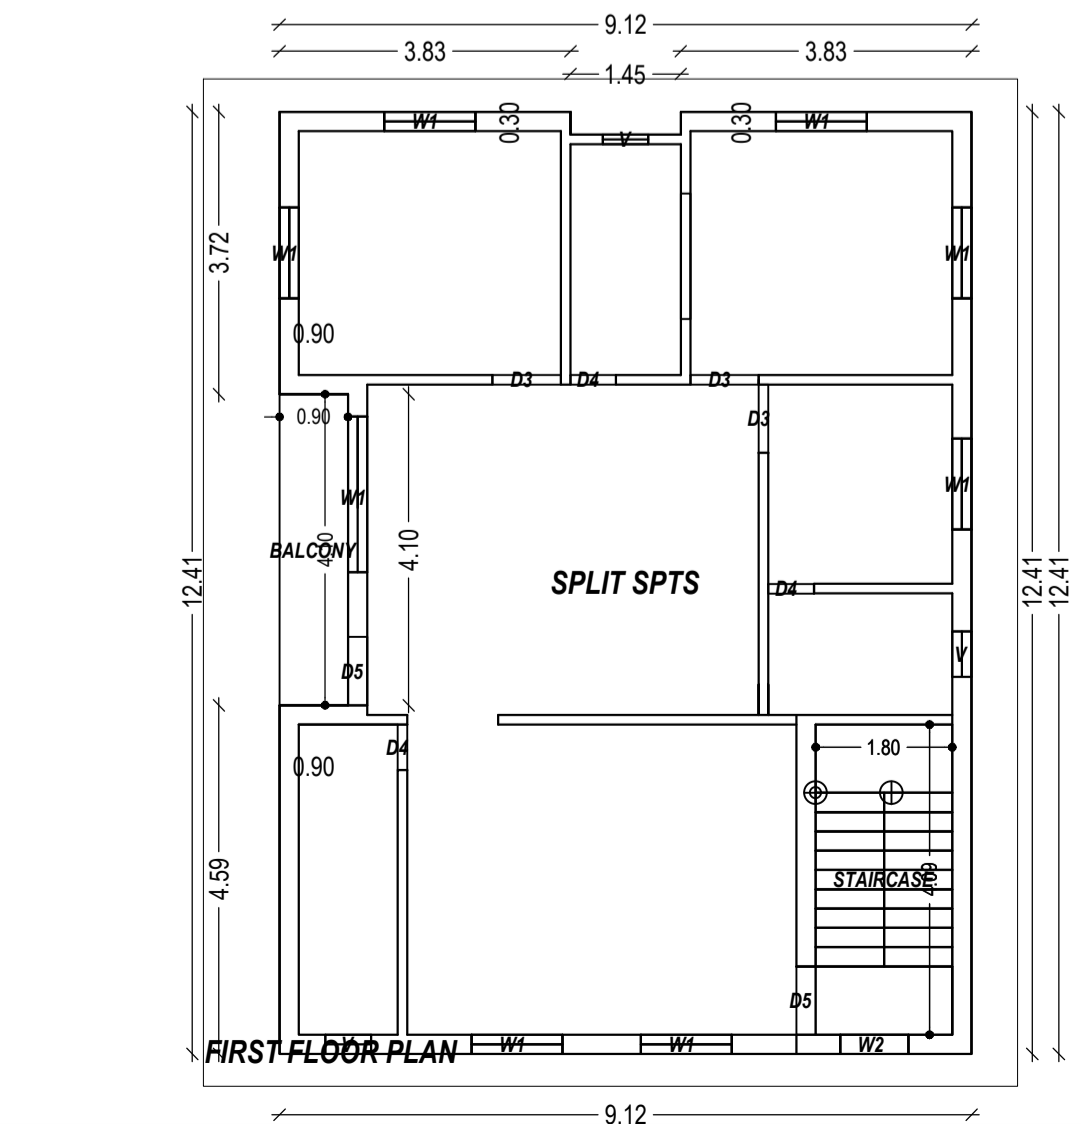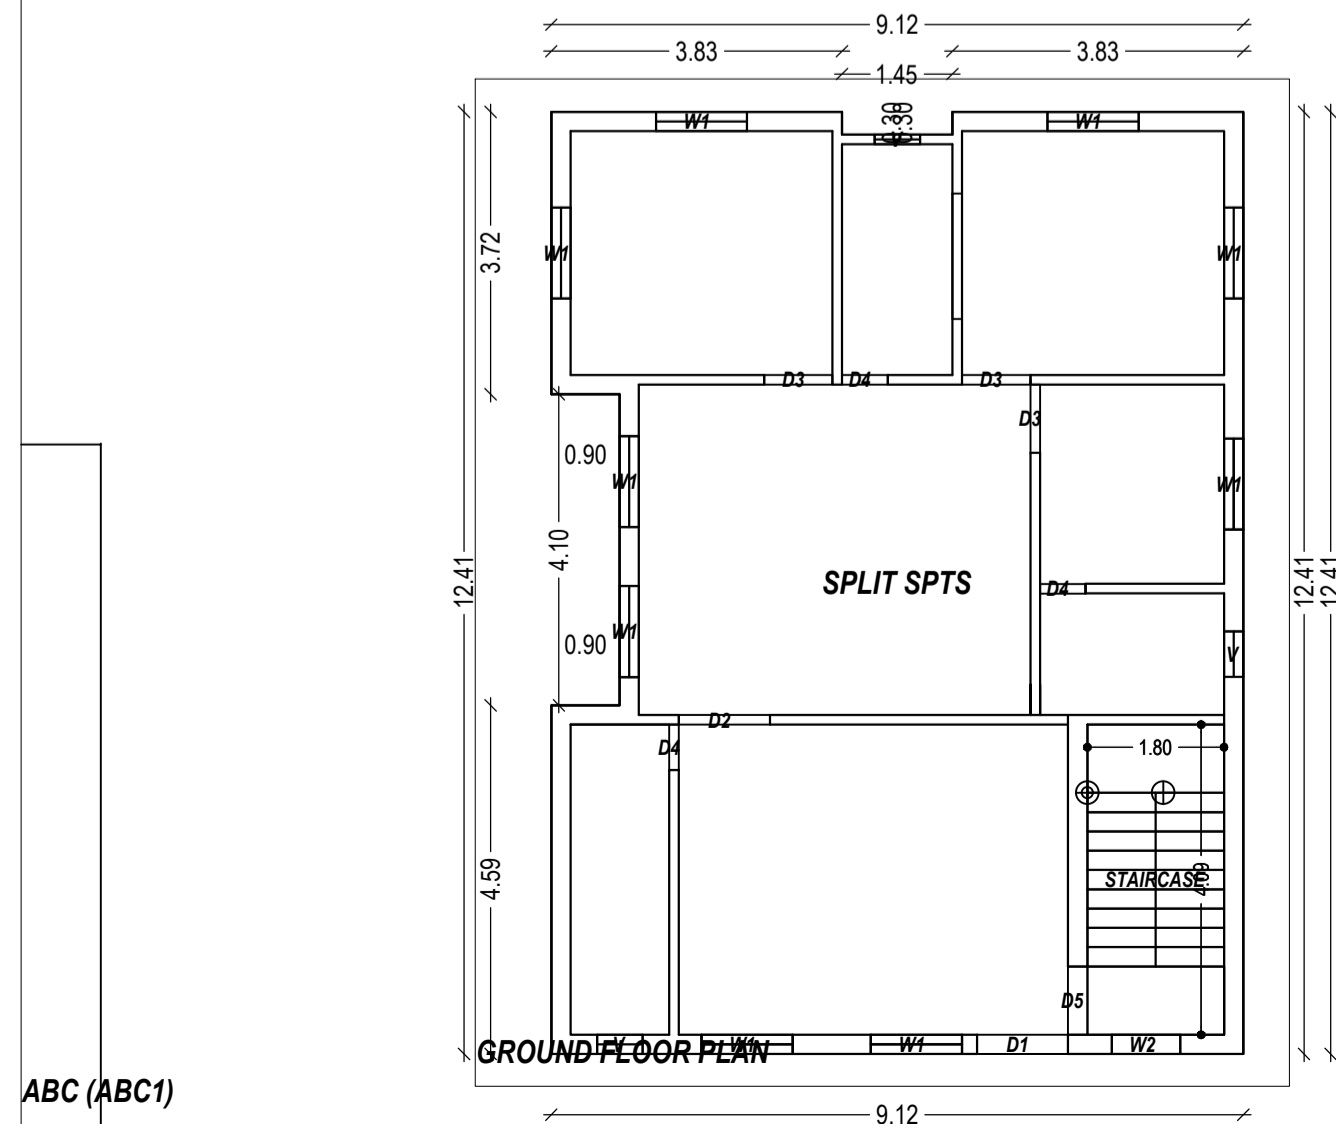

APPLICANT SIGNATURE

ENGG. SIGNATURE